


Pipe layout for Cooling QC test.

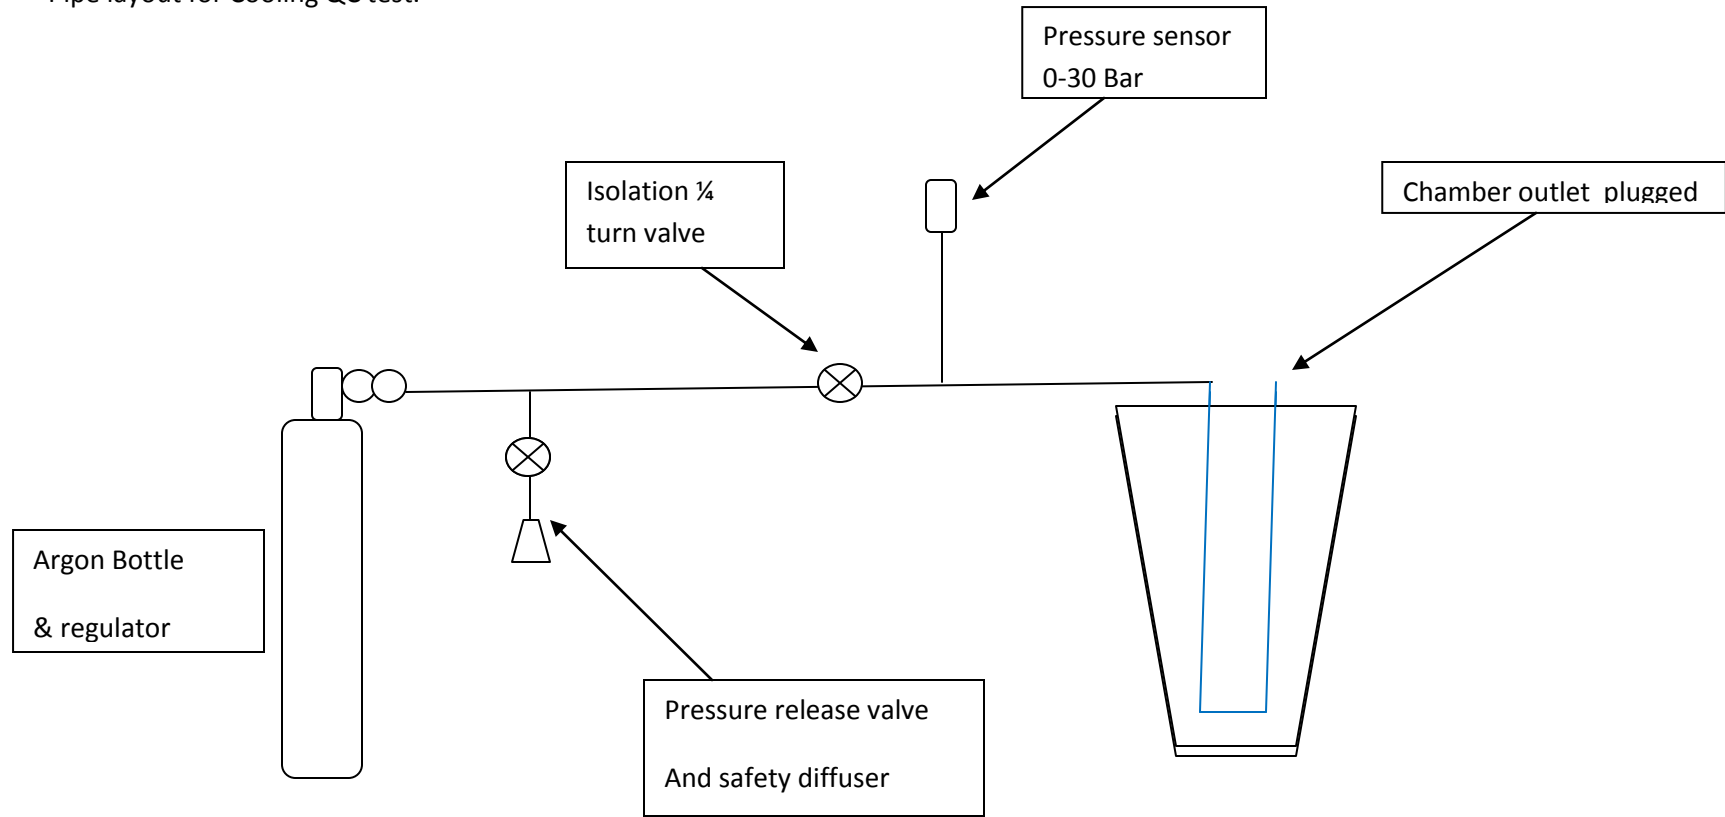

— 4x6mm piping L= 1.3m
— 6x8mm piping L= 0.2m chamber length

Ian Crotty
15 february